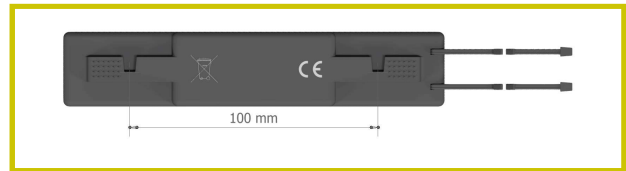

Installation of HeatMoniSpot

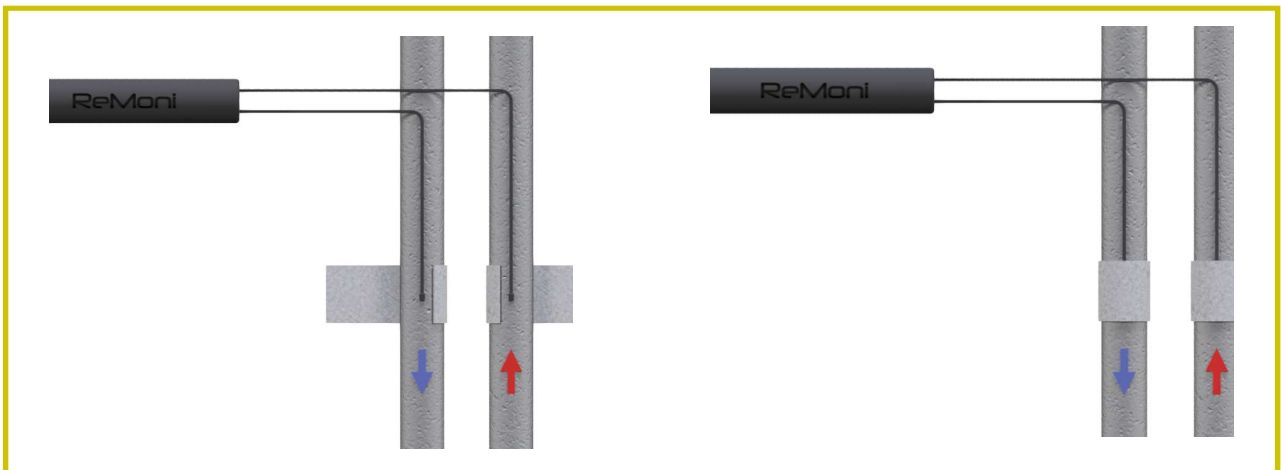
1. Log in to ReCalc: recalc.remoni.com and register a unit with the ID on the side of the sensor.



2. Mount the HeatMoniSpot on the wall using the mounting holes (see picture) or on a clean surface using the adhesive pads.



3. Tape the probes onto the pipes to be measured. The probes must be mounted directly onto the pipes and mounted so that they are not affected by external temperatures:
 - i. Mount at least 25 cm from larger pipe braids so it's not influenced by the temperatures from other pipes.
 - ii. Mount at least 25 cm from other temperature sources that can affect the sensor with heat or cold.



Do not mount the sensor in direct sunlight or near external temperature sources. This ensures that the sensor has the same air temperature as the measured pipes.

Note that it is possible to extend the probes by up to 10 meters.

Please note - ReMoni recommends installing the ReMoni Gateway before the sensor. After connecting the sensor, it can take up to 60 minutes before the measured values are visible in ReCalc: recalc.remoni.com. Data sheets can be found on ReMoni's website: remoni.com.